

Overview and Identification

BAPI's Rigid Averaging Temperature Transmitters come with a 1K Ω (385) RTD sensor element with a field adjustable output of 4 to 20 mA or 1 to 5, 0 to 5, 2 to 10, 0 to 10 VDC over a selected temperature range.

This transmitter can also be ordered in a variety of probe lengths and mounting enclosures as shown in the figures at right.

These transmitters are available with a wired connection via flying leads or a pluggable terminal block (-TS).

Special high accuracy RTD matched transmitters (M) are available which match the sensor to the transmitter for improved accuracy.

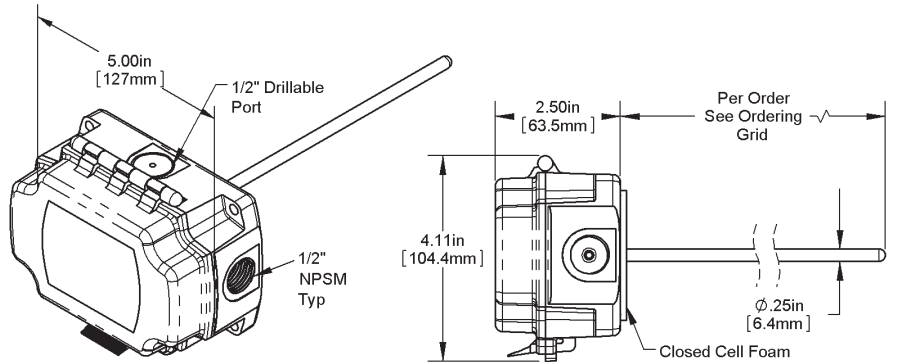


Fig. 1: Duct Unit with BAPI-Box (BB) Enclosure

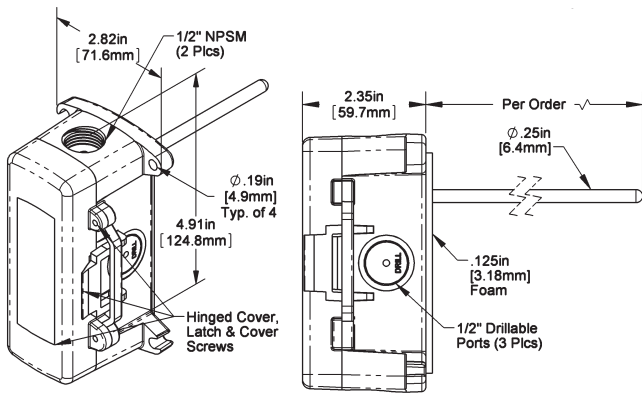


Fig. 2: Duct Unit with BAPI-Box 2 (BB2) Enclosure

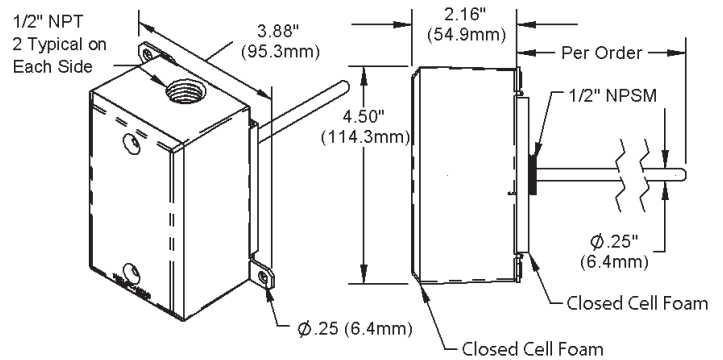


Fig. 3: Duct Unit with Weatherproof (WP) Enclosure


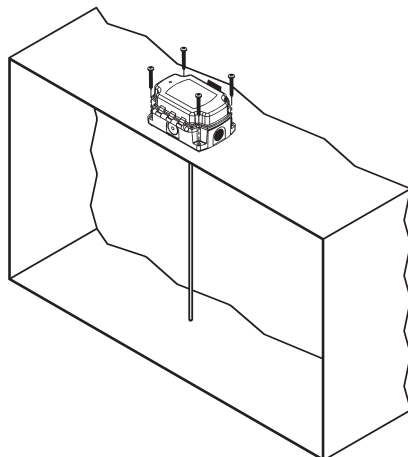


Fig. 4: Typical Duct Mount Applications - Top Mount (left) and Side Mount (right).

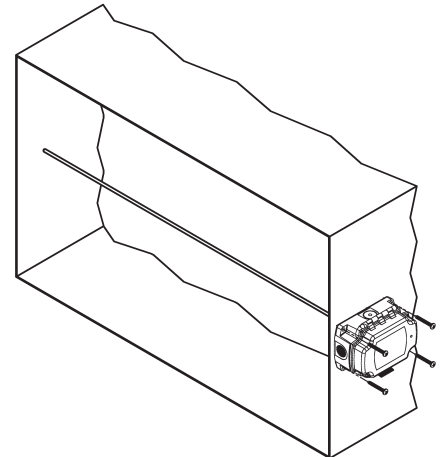

Mounting

1. Place the sensor in the middle of the duct away from temperature stratified air, coils or humidifiers to achieve the best temperature reading.
2. Drill the probe hole as depicted on this page for the enclosure being used. Insert the probe into the duct.
3. Mount the enclosure to the duct using BAPI recommended #8 screws through a minimum of two opposing mounting tabs. Weatherproof (WP) enclosures require assembly of the mounting tabs on opposite corners. A 1/8 inch pilot screw hole in the duct makes mounting easier through the mounting tabs. Use the enclosure tabs to mark the pilot hole locations.
4. Snug up the sensors so that the foam backing is depressed to prevent air leakage but do not over-tighten or strip the screw threads.

Note 1:

Do not drill into the water tight enclosures (BB, BB2, WP) which will violate the NEMA and/or IP rating.

Note 2:

Use caulk or Teflon tape for your conduit entries to maintain the appropriate NEMA or IP rating for your application.

Note 3:

Conduit entry for outdoor or wet applications should be from the bottom of the enclosure.

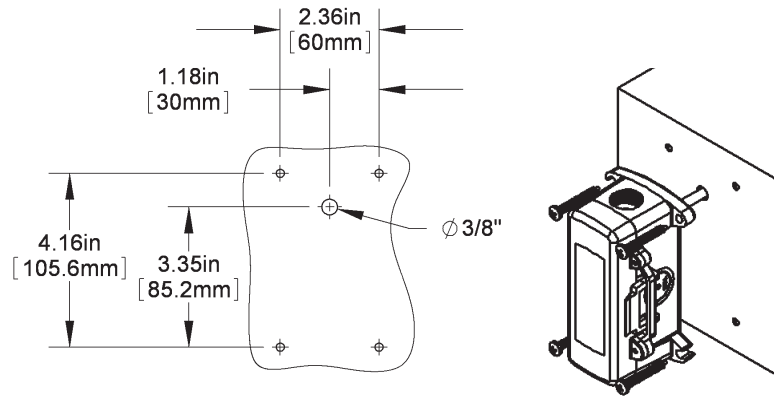


Fig. 5: BAPI-Box 2 (BB2) Enclosure Mounting Holes

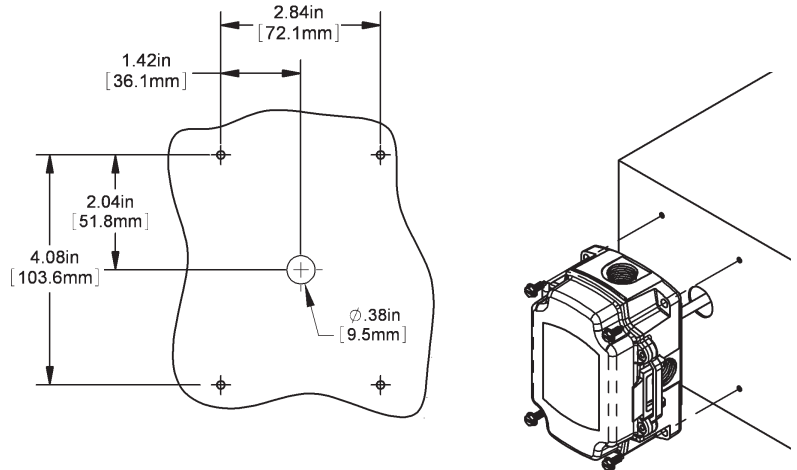


Fig. 6: BAPI-Box (BB) Enclosure Mounting Holes, Rotate 90° for Horizontal Mounting

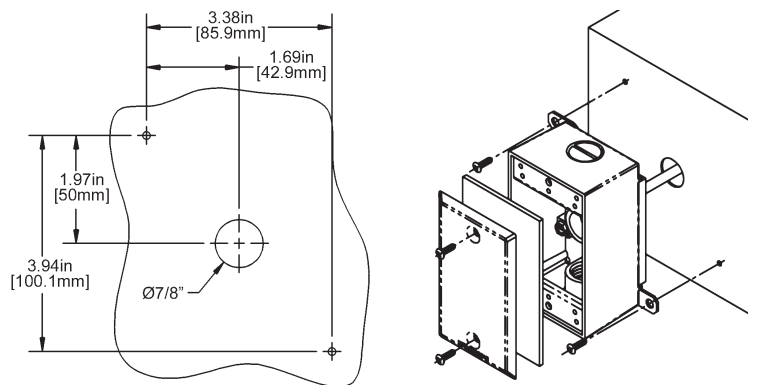


Fig. 7: Weatherproof (WP) Enclosure Mounting Holes

Termination

BAPI recommends using twisted pair of at least 22AWG and sealant filled connectors for all wire connections. Larger gauge wire may be required for long runs. All wiring must comply with the National Electric Code (NEC) and local codes. Do NOT run this device's wiring in the same conduit as AC power wiring of NEC class 1 or NEC class 2, NEC class 3 or with wiring used to supply highly inductive loads such as motors, contactors and relays. BAPI's tests show that fluctuating and inaccurate signal levels are possible when AC power wiring is present in the same conduit as the signal lines. *Note: Keep transmitter at least 5 feet from any radio wave-emitting device (ie: 2 way radio). Transmitters that are less than 5 feet from a radio wave-emitting device can cause unwanted interference.*



BAPI recommends wiring the product with power disconnected. Proper supply voltage, polarity, and wiring connections are important to a successful installation. Not observing these recommendations may damage the product and will void the warranty.

4 to 20mA Output with Flying Leads

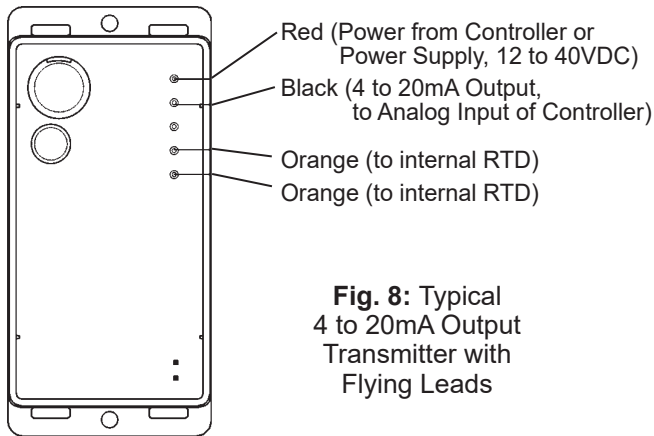


Fig. 8: Typical 4 to 20mA Output Transmitter with Flying Leads

4 to 20mA Output with Terminals

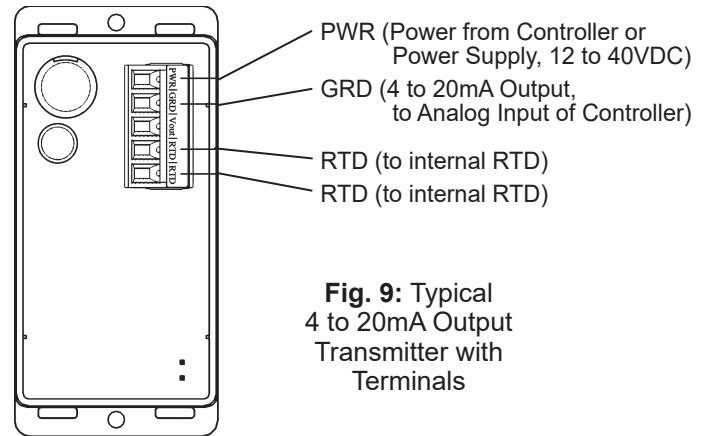


Fig. 9: Typical 4 to 20mA Output Transmitter with Terminals

Voltage Output with Flying Leads

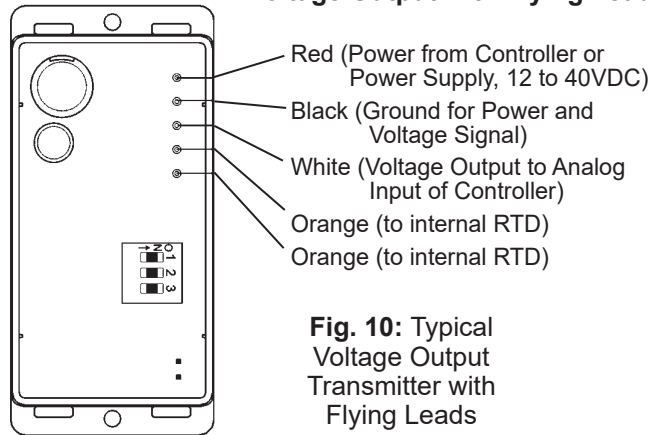


Fig. 10: Typical Voltage Output Transmitter with Flying Leads

Voltage Output with Terminals


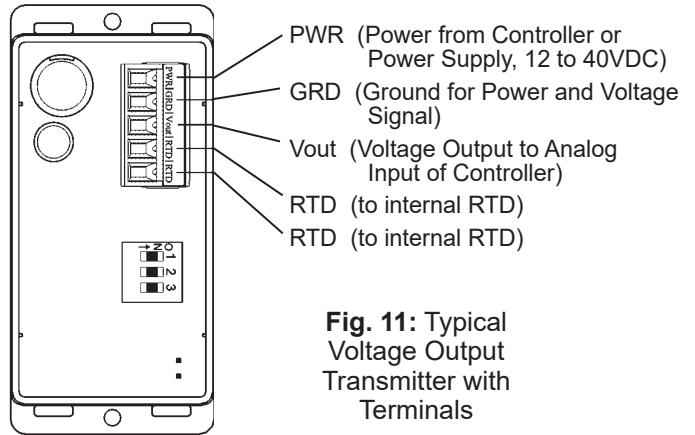



Fig. 11: Typical Voltage Output Transmitter with Terminals

DIP Switch Settings for Field-Selectable Voltage Output Units

The circuit board for voltage output units has a 3-position DIP switch that controls the output value. This switch is set at the factory at the time of the order but may be changed in the field.

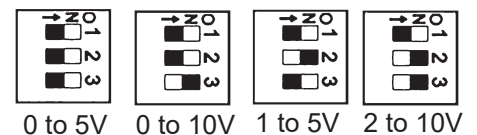

Note: Units ordered with Voltage Output can be switched to 4 to 20mA output with the DIP switch setting shown at right. The middle flying lead or middle terminal would not be used in that case and the unit would be wired similar to Figs 8 and 9 above.





Diagnostics

Possible Problems:

- Unit will not operate.

Possible Solutions:

- Measure the power supply voltage by placing a voltmeter across the transmitter's (+) and (-) terminal. Make sure that it matches the drawings above and power requirements in the specifications.
- Check if the RTD wires are physically open or shorted together and are terminated to the transmitter.
- Determine if the input is set up correctly in the controllers and BAS software.
- For a 4 to 20mA current transmitter measure the transmitter current by placing an ammeter in series with the controller input. The current should read according to the "4 to 20mA Temperature Equation" shown below.
- For a voltage transmitter, measure the signal with a volt meter (Orange or Orange/Black to Black). The signal should read according to the "Voltage Temperature Equation" shown below.

- The reading is incorrect in the controller.

4 to 20mA Temperature Equation

$$T = T_{Low} + \frac{(A - 4) \times (T_{Span})}{16}$$

- T = Temperature at sensor
- T_{Low} = Low temperature of span
- T_{High} = High temperature of span
- T_{Span} = T_{High} - T_{Low}
- A = Signal reading in mA

Voltage Temperature Equation

$$T = T_{Low} + \frac{(V \times T_{Span})}{V_{Span}}$$

- T = Temperature at sensor
- T_{Low} = Low temperature of span
- T_{High} = High temperature of span
- T_{Span} = T_{High} - T_{Low}
- V_{Low} = Low transmitter voltage usually=(0, 1 or 2v)
- V_{High} = High transmitter voltage usually=(5 or 10v)
- V_{Span} = V_{High} - V_{Low}
- V = Signal reading in volts

Specifications

Transmitter Circuit

- Power Required:..... 12 to 40VDC
- Transmitter Output:..... 4 to 20mA, 0 to 5, 1 to 5, 0 to 10 or 2 to 10VDC, 850Ω@24VDC
- Output Wiring:..... 2 wire loop
- Output Limits: <1mA (short), <22.35mA (open)
- Span: Min. 30°F (17°C), Max 1000°F, (555°C)
- Zero: Min. -148°F (-100°C), Max 900°F (482°C)
- System Accuracy: ±0.065% of span
- Linearity: ±(0.125 * T-20°C)/100
- RTD Sensor: 2 wire Platinum (Pt), 385 curve
- Transmitter Ambient: .. -4 to 158°F (-20 to 70°C) 0 to 95% RH, Non-condensing

- RTD Sensor:** Resistance Temp Device (Bare Sensor)
- Platinum RTD: 1KΩ @ 0°C, 385 curve
- Sensitivity: 3.85Ω/°C, Approximate @ 32°F (0°C)
- Accuracy (Standard): .. 0.12% @Ref, or ±0.55°F, (±0.3°C)
- Accuracy (High): 0.06% @Ref, or ±0.277°F, (±0.15°C), [A]option

- Stability: ±0.25°F, (±0.14°C)
- Self Heating: 0.4 °C/mW @0°C
- Probe Range: -40 to 221°F, (-40 to 105°C)

Lead Wire: 22awg stranded

Insulation: Etched Teflon, Plenum rated

Probe: Flexible Copper Tube, 0.19"OD

Probe Length: 1', 2', 3', 4' or per order

Duct Gasket: 1/4" Closed cell foam (impervious to mold)

Enclosure Types: (Part number designator in bold)
 Weatherproof: **-WP**, w/ two 1/2" FNPT entries, (Bell box)
 BAPI-Box: **-BB**, w/ four 1/2" NPSM & one 1/2" drill-out
 BAPI-Box 2: **-BB2**, w/ three 1/2" NPSM & three 1/2" drill-outs

Enclosure Ratings: (Part number designator in bold)
 Weatherproof: **-WP**, NEMA 3R, IP14
 BAPI-Boxes: **-BB, BB2**, NEMA 4, IP66, UV Rated

Enclosure Material: (Part number designator in bold)
 Weatherproof: **-WP**, Cast Aluminum, UV rated
 BAPI-Boxes: **-BB, BB2** Polycarb., UL94V-0, UV rated

Ambient (Encl.) .. 0 to 100% RH, Non-condensing
 BAPI-Boxes: **-BB, BB2**, -40°F to 185°F, (-40° to 85°C)
 BAPI-Box 2: **-BB2**, -40°F to 185°F, (-40° to 85°C)

Agency
 CE EN 61326-1:2013 EMC (Industrial Electromagnetic Environment) / RoHS / PT=DIN43760, IEC Pub 751-1983 / JIS C1604-1989

Specifications subject to change without notice.